

Note: Do not use wrenches on hose or braid collar.

				Training and the rest of the second of the s			
Qty Model Size I.D. (in)		Size I.D. (in)	A (in)	Pressure @ 70°F (PSI)	Weight (Lbs)	Project Info	
	GASCT0050	1/2	16-7/8	150	0.8		
	GASCT0075	3/4	18-3/8	150	1.4		
	GASCT0100	1	19-3/8	150	1.8		
	GASCT0125	1-1/4	19-3/8	150	2.3		
	GASCT0150	1-1/2	20-1/8	150	2.9		
	GASCT0200	2	20-7/8	150	3.9		
	GASCT0250	2-1/2	22-1/2	150	5.7		
	GASCT0300	3	25-5/8	150	8.1		
	GASCT0400	4	30-1/4	150	11.9		


MAX INTERMITTENT OFFSET FROM CENTERLINE: 2" CONTACT METRAFLEX FOR CUSTOM LENGTHS.

## **NSF 372 - LEAD FREE**


The wetted surface of this product contacted by consumable water contains less than one quarter of one percent (0.25%) of lead by weight. Material complies with state codes and standards, where applicable, requiring reduced lead content. Not suitable for potable water systems due to materials of construction.



CUSTOMER:		
PROJECT:		
ENGINEER:		

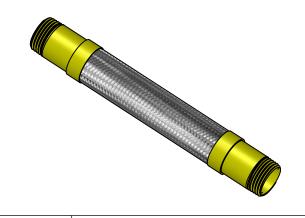

REV.	4	OFFSET U	JPDATED	)	DAT	E 10/26/2	2016
for pip	es in	ra motion	<b>l</b> e	X TE	323 W. HU :HICAGO, EL: 312-738 AX: 312-73 VWW.METF	IL 60612 3-3800 8-0415	
		MOE	<b>DEL</b>	GA	SCT	•	
FLEX	IBLE	CONN	ECTO	R FO	R GAS	SERVI	CE
DRAWN	BY: <b>D</b>	KISH		DATE:	1/10/2		
APPROV	/ED: <b>J(</b>	:		DATE:	1/10/2	014	
scale:	/A	DRAWING		R: SASC	T-4		

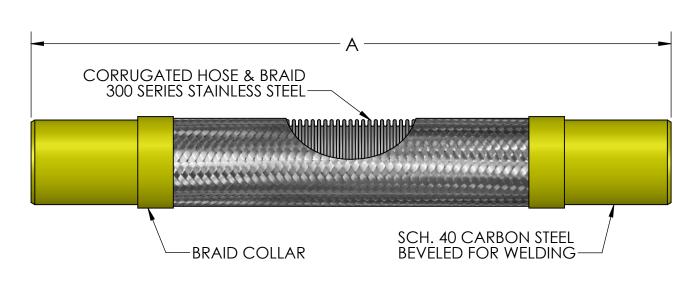

Note: Do not use wrenches on hose or braid collar.

	T					
Qty	Model	Size I.D. (in)	A (in)	Pressure @ 70°F (PSI)	Weight (Lbs)	Project Info
	GASCW0050	1/2	16-7/8	150	0.8	
	GASCW0075	3/4	18-3/8	150	1.4	
	GASCW0100	1	19-3/8	150	1.8	
	GASCW0125	1-1/4	19-3/8	150	2.3	
	GASCW0150	1-1/2	20-1/8	150	2.9	
	GASCW0200	2	20-7/8	150	3.9	
	GASCW0250	2-1/2	22-1/2	150	5.7	
	GASCW0300	3	25-5/8	150	8.1	
	GASCW0400	4	30-1/4	150	11.9	


MAX INTERMITTENT OFFSET FROM CENTERLINE: 2" CONTACT METRAFLEX FOR CUSTOM LENGTHS.

## **NSF 372 - LEAD FREE**

The wetted surface of this product contacted by consumable water contains less than one quarter of one percent (0.25%) of lead by weight. Material complies with state codes and standards, where applicable, requiring reduced lead content. Not suitable for potable water systems due to materials of construction.



CUSTOMER:	
PROJECT:	
ENGINEER:	



REV.	4	OFFSET	UPDATE	D	DATE	10/26/2016
for pip	es in	ro motion	<b>l</b> e	2 X § F V	1323 W. HUBI CHICAGO, IL EL: 312-738- AX: 312-738 VWW.METR <i>A</i>	BARD ST. - 60612 3800 -0415 AFLEX.COM
	٨	VOD	EL	GA	SCW	
FLEX	IBLE	CONN	ECTO	R FC	R GAS S	SERVICE
DRAWN	BY: <b>D</b> I	KISH		DATE:	1/10/20	14
APPROV	ED: <b>J(</b>	:		DATE:	1/10/20	14
scale: N/	′A	DRAWING		ER: SASC	W-4	