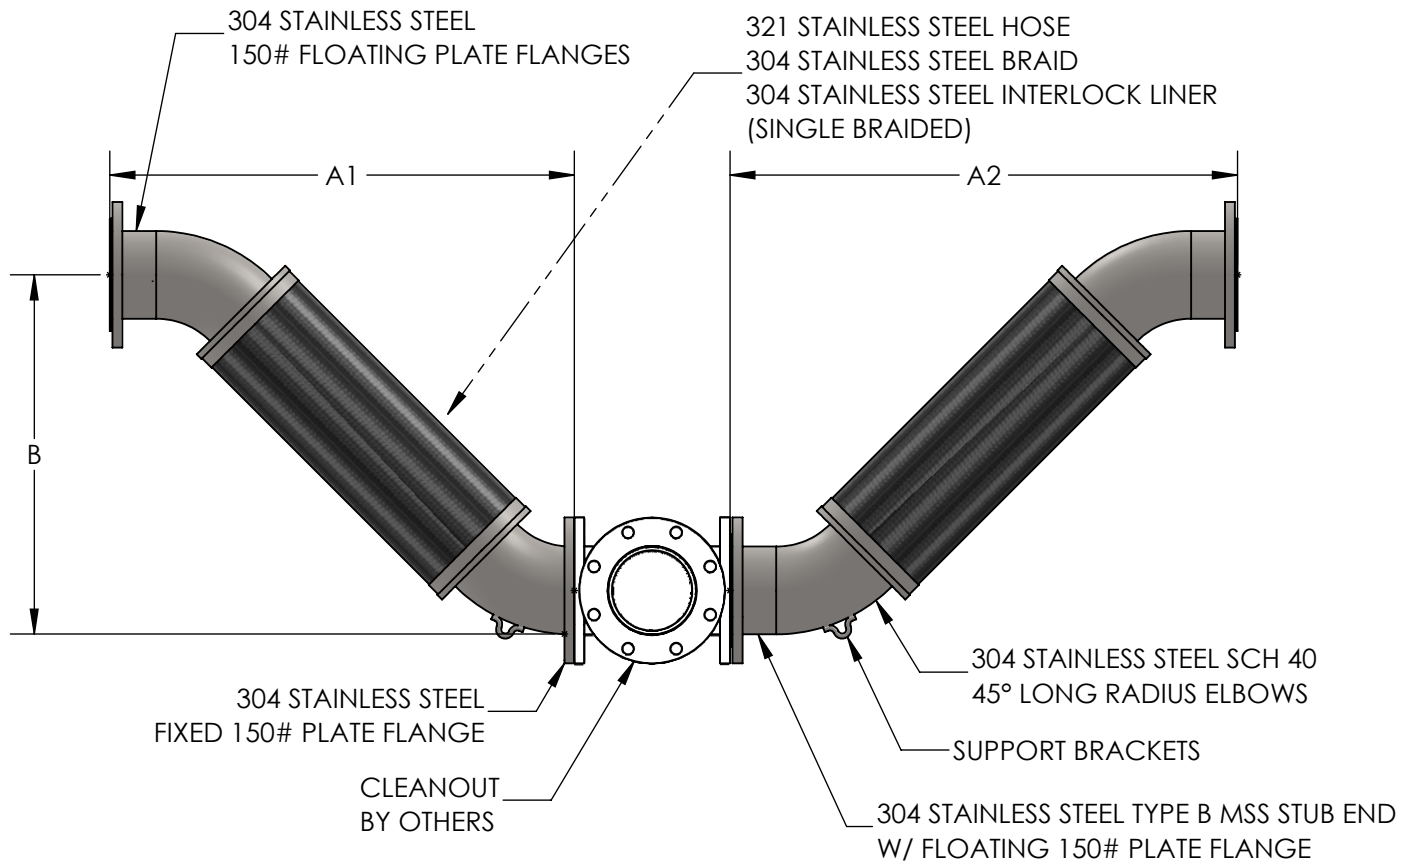


File No. C-9261

NOTE: DWV METRALOOPS INSTALLED IN ANY ORIENTATION OTHER THAN HANGING DOWN MUST HAVE THE RETURN SUPPORTED. (SEE INSTALLATION INSTRUCTIONS).

QTY	PART NUMBER	PIPE SIZE	A1	A2	B	MOVEMENT	PRESSURE RATING	PROJECT INFO
	VLFILP80400	4"	28-3/8"	31-1/8"	22-3/8"	±4"	150 PSI @ 70°F	
	VLFILP80600	6"	35-1/8"	38-3/8"	27-1/8"	±4"	150 PSI @ 70°F	
	VLFILP80800	8"	41-3/4"	45-1/2"	31-7/8"	±4"	150 PSI @ 70°F	
	VLFILP81000	10"	48-3/4"	53-1/2"	36-3/8"	±4"	150 PSI @ 70°F	
	VLFILP81200	12"	56"	61-3/4"	41-1/8"	±4"	150 PSI @ 70°F	

CUSTOMER: _____

PROJECT: _____

ENGINEER: _____

REV.	DATE
2323 W. HUBBARD ST. CHICAGO, IL 60612 TEL: 312-738-3800 FAX: 312-738-0415 WWW.METRAFLEX.COM	
DWV V-LOOPS, FLOATING FLANGES, ±4" MOVEMENT, CLEANOUT BY OTHERS	
DRAWN BY: JULIANH	DATE: 04/10/2025
APPROVED:	DATE:
SCALE: N/A	DRAWING NUMBER: VLFILP8-1