
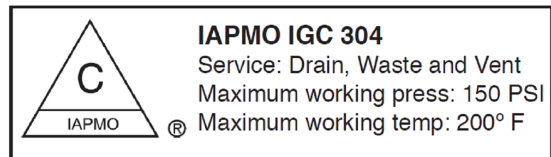


D.W.V. METRALOOP 150# FLOATING FLANGES ± 8" MOVEMENT

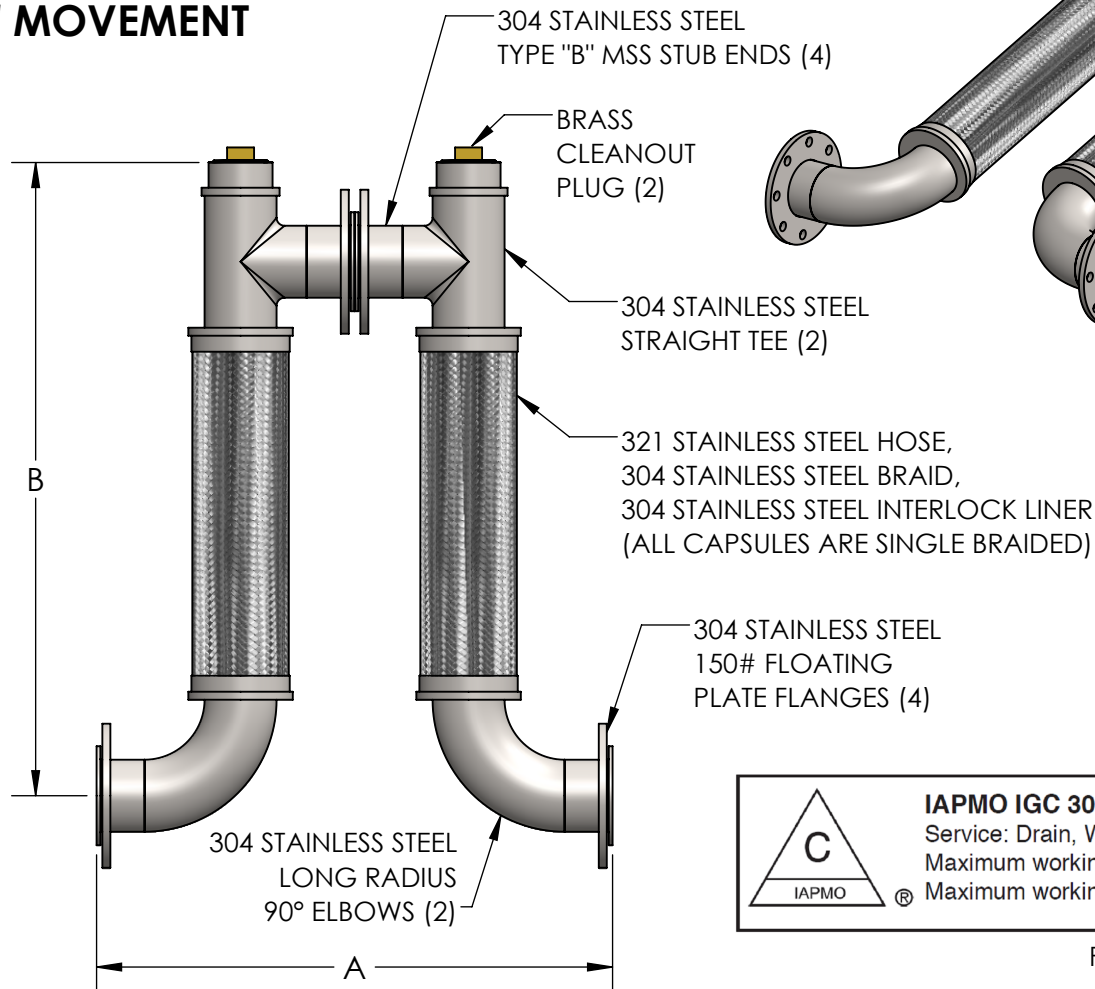

File No. C-9261

NOTE: D.W.V. METRALOOPS INSTALLED IN ANY ORIENTATION OTHER THAN HANGING DOWN MUST HAVE THE 180° RETURN SUPPORTED. (SEE INSTALLATION INSTRUCTIONS.)

CONTACT FACTORY FOR ADDITIONAL SIZES AND MOVEMENTS. ALL DIMENSIONS IN INCHES.

| QTY | SIZE | MODEL | MVMT | A | B | PSI* | SPRING FORCE** | PROJECT INFO |
|-----|------|--------------|------|--------|-----|------|----------------|--------------|
| | 4" | MLFILP160400 | ±8" | 32.25" | 47" | 150 | 375 | |
| | 5" | MLFILP160500 | ±8" | 36.75" | 52" | 150 | 405 | |


*Working temperature listed is the rating at 70°F. Contact factory for other pressure ratings at other temperatures.

**Spring force: The total force (Lbs) required to move the Metraloop its full rated movement for 150 PSI @ 70°F.

CUSTOMER: _____

PROJECT: _____


ENGINEER: _____

| | |
|---|--------------------------------|
| REV. | DATE |
|  | |
| 2323 W. HUBBARD ST. CHICAGO, IL 60612 TEL: 312-738-3800 FAX: 312-738-0415 WWW.METRAFLEX.COM | |
| D.W.V. METRALOOP, FLOATING FLANGES, ±8" MOVEMENT | |
| DRAWN BY: DKISH | DATE: 5/29/2015 |
| APPROVED: JC | DATE: 5/29/2015 |
| SCALE: N/A | DRAWING NUMBER: MLFILP16-4AND5 |

D.W.V. METRALOOP

150# FLOATING FLANGES

±8" MOVEMENT

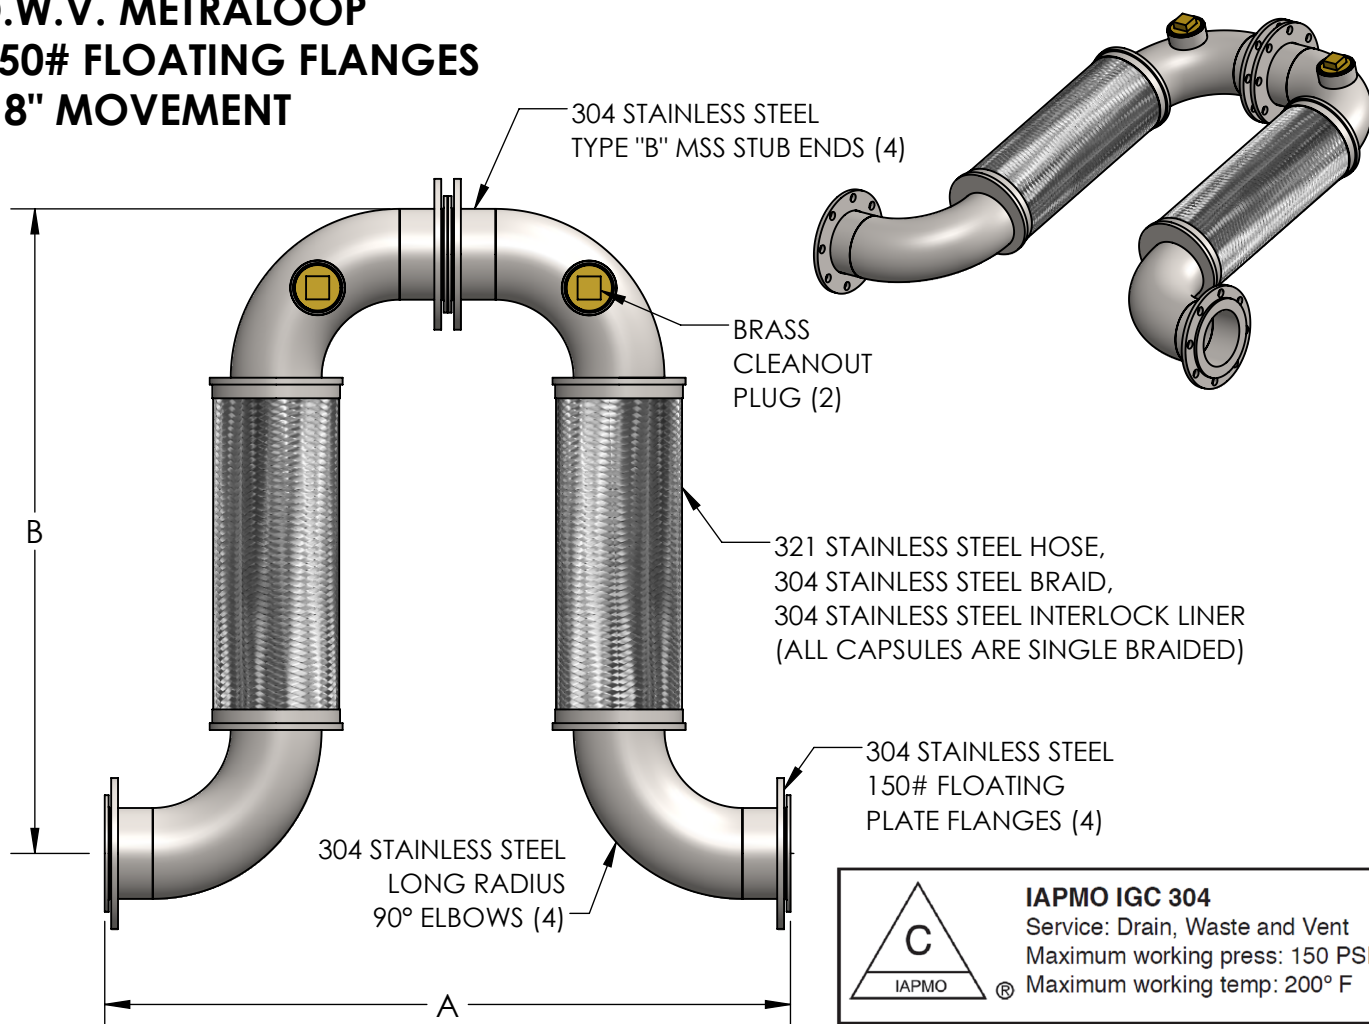

File No. C-9261

NOTE: D.W.V. METRALOOPS INSTALLED IN ANY ORIENTATION OTHER THAN HANGING DOWN MUST HAVE THE 180° RETURN SUPPORTED. (SEE INSTALLATION INSTRUCTIONS.)

CONTACT FACTORY FOR ADDITIONAL SIZES AND MOVEMENTS. ALL DIMENSIONS IN INCHES.

| QTY | SIZE | MODEL | MVMT | A | B | PSI* | SPRING FORCE** | PROJECT INFO |
|-----|------|--------------|------|-----|-----|------|----------------|--------------|
| | 6" | MLFILP160600 | ±8" | 50" | 56" | 150 | 520 | |
| | 8" | MLFILP160800 | ±8" | 64" | 67" | 150 | 600 | |
| | 10" | MLFILP161000 | ±8" | 80" | 77" | 150 | 800 | |
| | 12" | MLFILP161200 | ±8" | 96" | 86" | 150 | 1400 | |


*Working temperature listed is the rating at 70°F. Contact factory for other pressure ratings at other temperatures.

**Spring force: The total force (Lbs) required to move the Metraloop its full rated movement for 150 PSI @ 70°F.

CUSTOMER: _____

PROJECT: _____

ENGINEER: _____

| | |
|---|--------------------------------|
| REV. | DATE |
|  | |
| 2323 W. HUBBARD ST. CHICAGO, IL 60612 TEL: 312-738-3800 FAX: 312-738-0415 WWW.METRAFLEX.COM | |
| D.W.V. METRALOOP, FLOATING FLANGES, ±8" MOVEMENT | |
| DRAWN BY: DKISH | DATE: 5/29/2015 |
| APPROVED: JC | DATE: 5/29/2015 |
| SCALE: N/A | DRAWING NUMBER: MLFILP16-6TO12 |